




**TA-COMFORT**  
**Fußbodenheizungs-Station / Radiant Heating Interface Unit**  
**Dynalux TA-COMPACT-P**

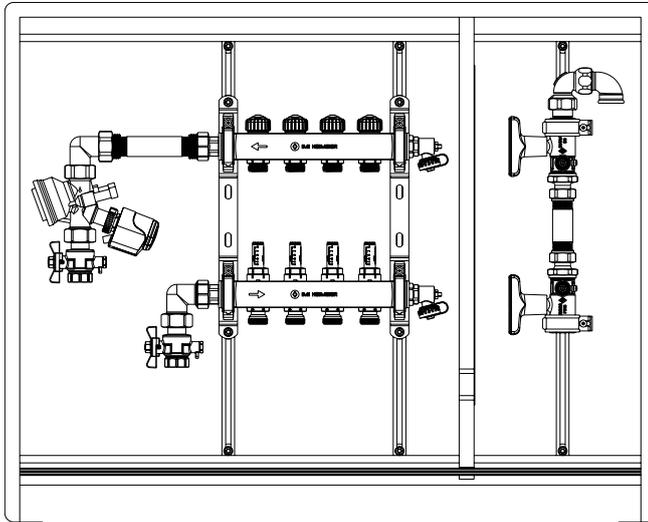

- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12

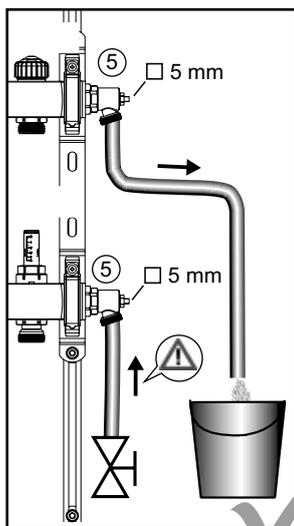

Gedruckt auf chlorfrei gebleichtem Papier.

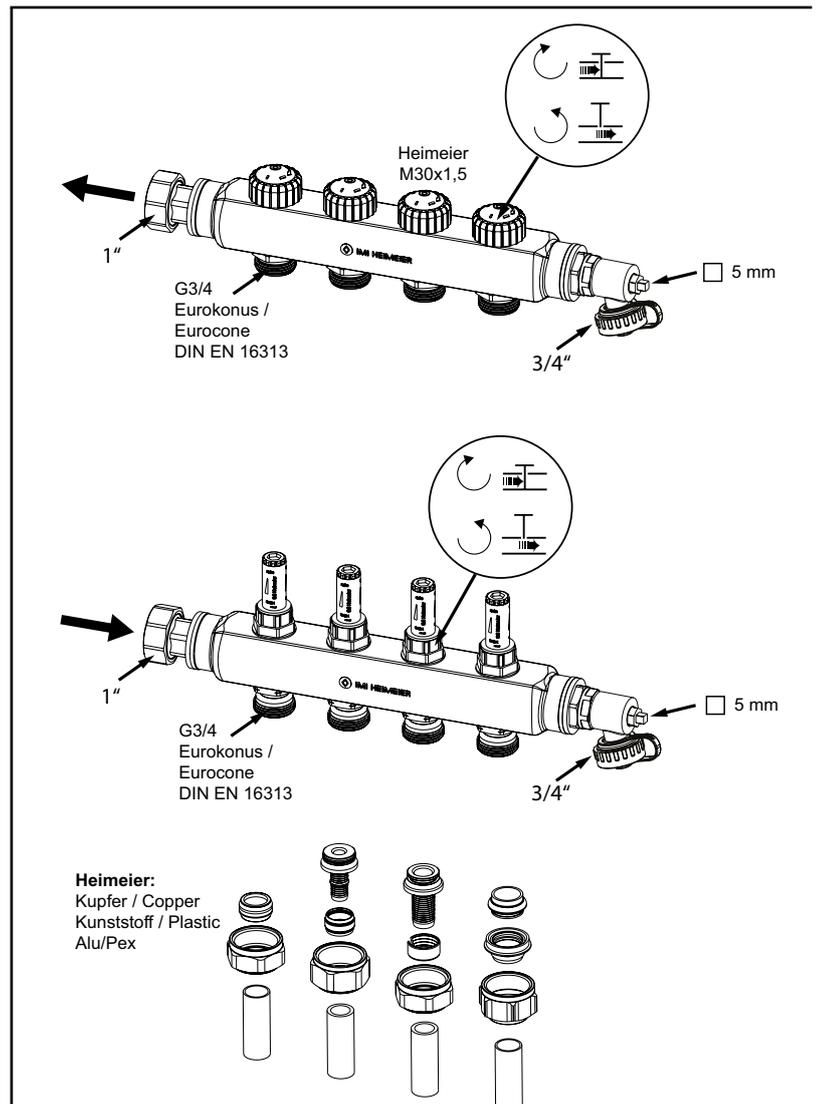



*We reserve the right to introduce technical alterations without previous notice.*

**Achtung!**

Den Durchflussmengenanzeiger zur Einregulierung nur mit dem Handrad betätigen. **Nicht** das Schauglas drehen!

**Attention!**

Only use the handwheel to operate the flow indicator for pre-setting purposes, ensuring that the locking cap is removed. Do **not** turn the viewing glass!

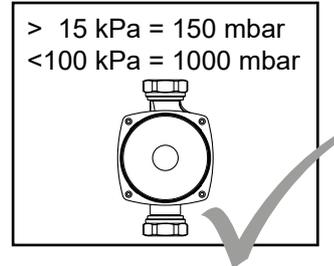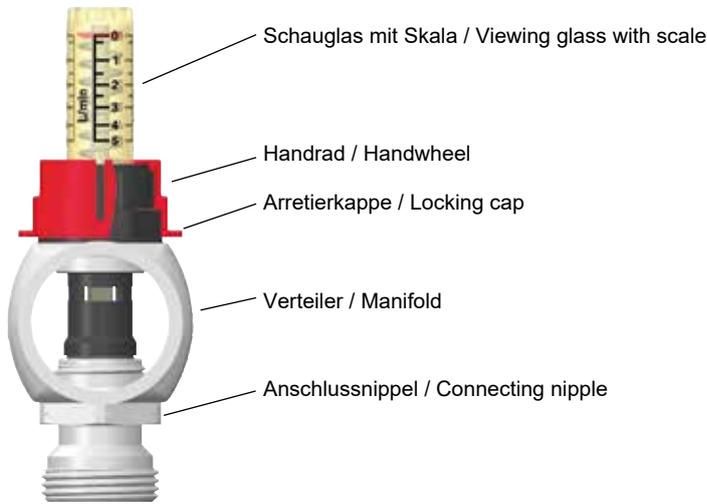

**Bedienung Durchflussmengenanzeiger 0 bis 5 l/min**

Der Durchflussmengenanzeiger auf dem Vorlauf-Verteiler wird mit aufgesetzter Arretierkappe ausgeliefert. Zum Einregulieren der Anlage bzw. Einstellen des Durchflussmengenanzeigers muss die Arretierkappe abgezogen werden. Die Regulierung erfolgt durch Verdrehen des Handrades bei laufender Umwälzpumpe.

Die durch das Ventil fließende Wassermenge ist direkt vom Öffnungsgrad des Ventils abhängig. Die durchströmende Wassermenge kann am Schauglas abgelesen werden. Zum Einregulieren der Anlage sind alle Hand- und Thermostatventile im gesamten Kreislauf vollständig zu öffnen.

Durch Drehen des Handrades wird die für den Heizkreis berechnete Wassermenge in l/min eingestellt (eventuell Wassermenge pro Heizkreis auf dem Verteiler vermerken).

Nach der Einregulierung der gesamten Anlage, die ersten Einstellungen nochmals kontrollieren und gegebenenfalls nachregulieren. Nach der definitiven Einstellung wird mit der Arretierkappe der Durchflussmengenanzeiger vor unbefugtem oder versehentlichem Verstellen geschützt. Hierzu ist die Arretierkappe wieder aufzusetzen.

Die Einbaulage ist beliebig, d. h. Anzeige nach oben, nach unten, horizontal oder schräg. Der Durchflussmengenanzeiger ist komplett absperbar!

**Achtung! Wartungsarbeiten dürfen nur im drucklosen Zustand erfolgen!**

**Operation of 0 to 5 l/min flow meter**

The flow meter on the supply manifold is supplied with an attached locking cap. Before you can preset the system/set the flow meter, the locking cap has to be removed. To make adjustments, turn the handwheel while the circulating pump is running.


The amount of water flowing through the valve is directly related to the extent to which it is open. You can see how much water is flowing through by looking at the viewing glass. To preset the system, all the manual and thermostatic valves in the entire circuit must be opened completely.

Turn the handwheel to set the amount of water calculated for the heating circuit in l/min (where applicable, record the amount of water per heating circuit on the manifold).

Once the entire system has been preset, check the initial settings again and make further adjustments where necessary. Once the definitive settings have been made, the locking cap must be used to secure the flow meter so that no unauthorised or accidental adjustments can be made. To do this, install the locking cap again. Any mounting position is possible, i.e. the indicator can be pointing up, pointing down, horizontal or slanting. The flow meter can be shut-off completely!

**Attention! Maintenance work may only be carried out when the system is depressurised!**

**Druckverlustdiagramm für Durchflussmengenanzeiger 0 - 5 l/min (im Vorlauf)**  
Pressure loss diagram for 0 - 5 l/min flow indicator (in supply pipe)

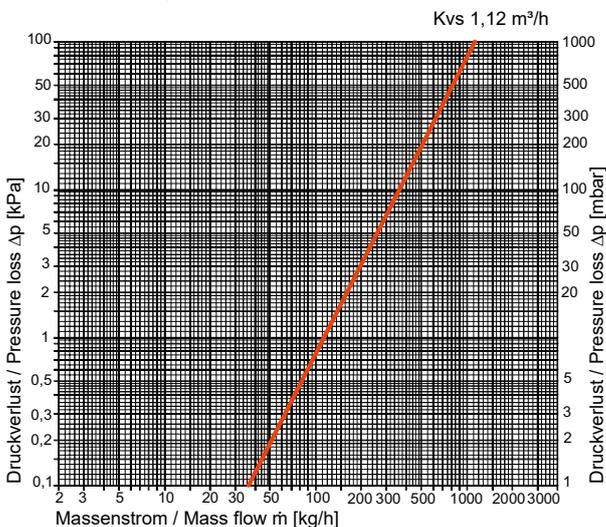

**Druckverlustdiagramm für Thermostatventil (im Rücklauf)**  
Pressure loss diagram for thermostatic valve (in return pipe)

