


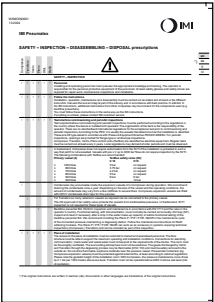




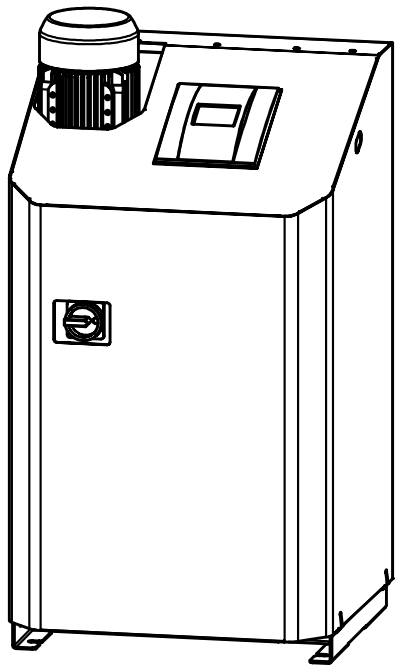


IMI Pneumatex

Vento VI Connect  
VI 19/25  
install

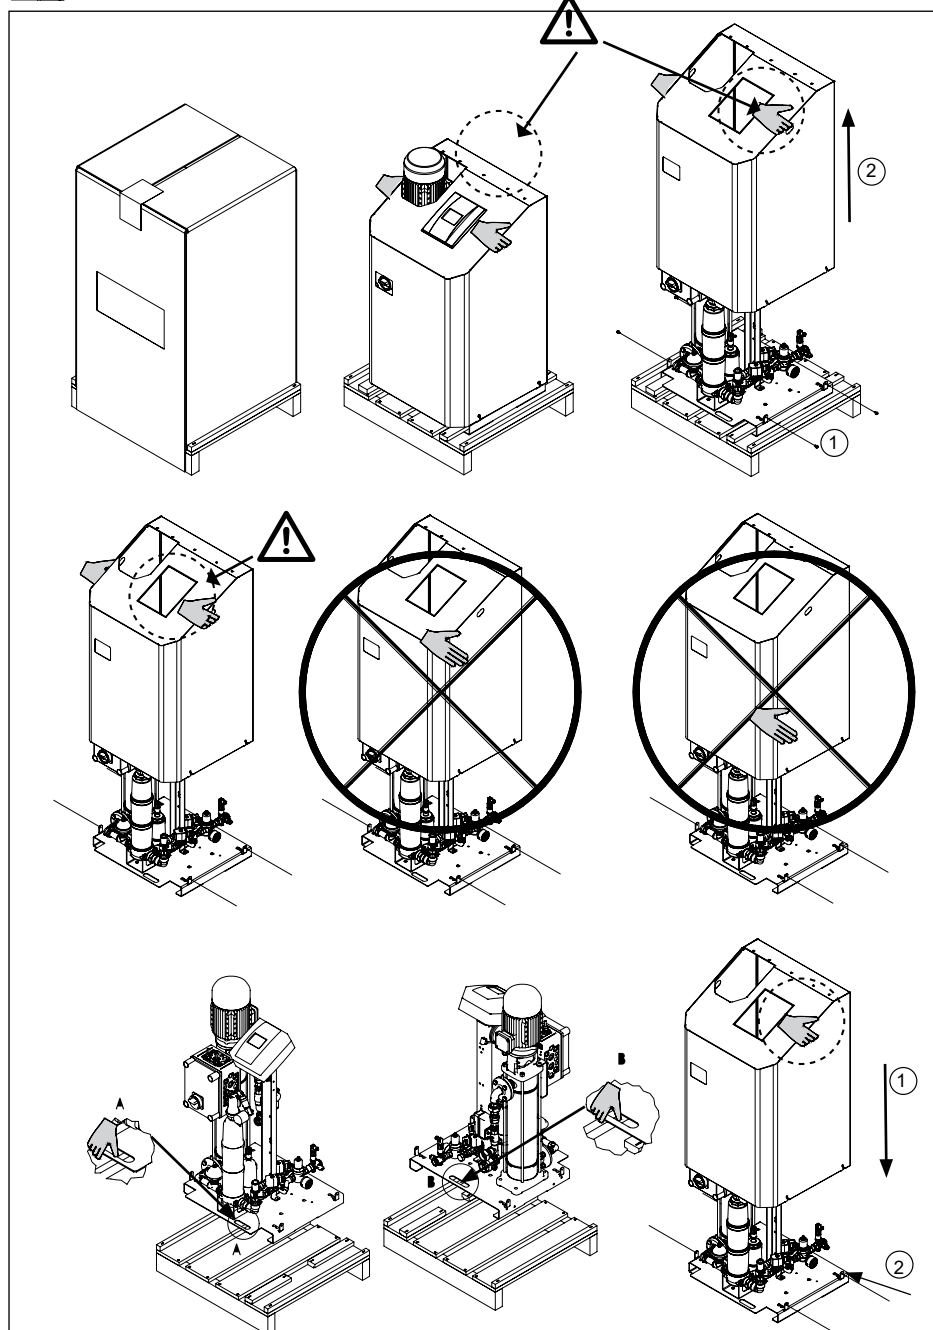




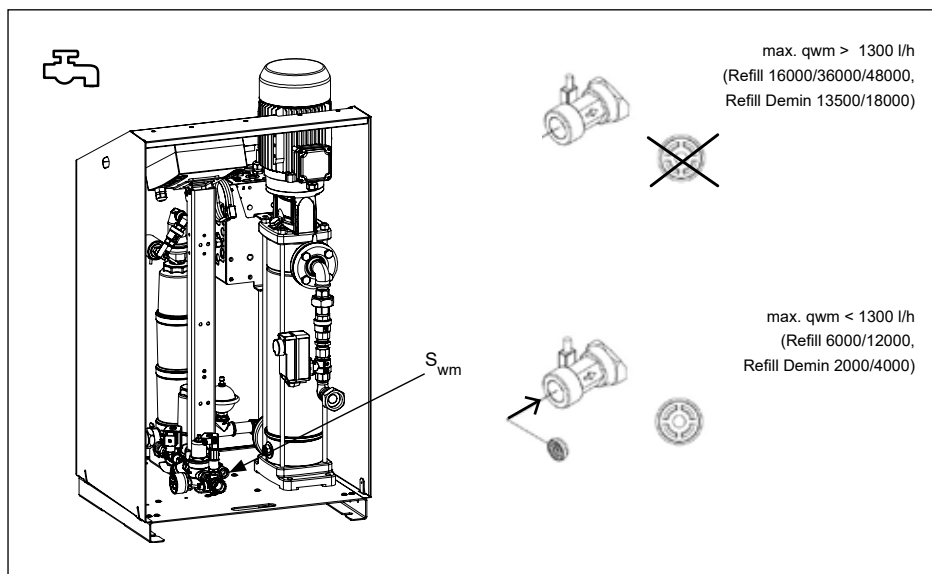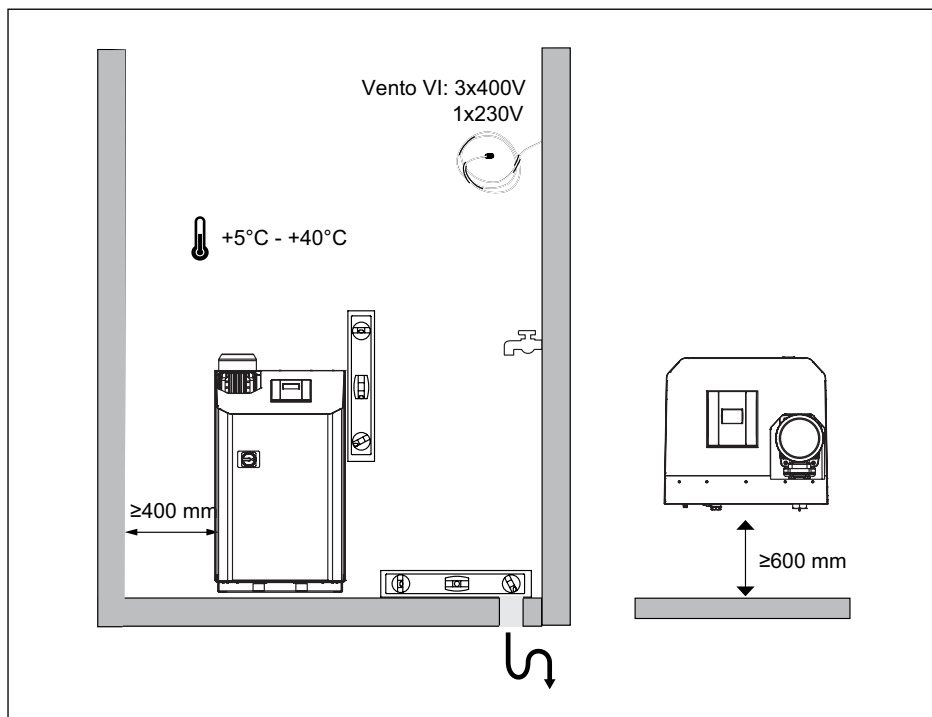


Vento VI\_.1



Optional

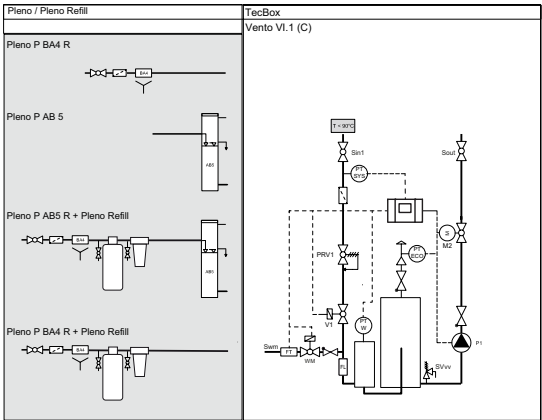

VI 19.1, VI 25.1

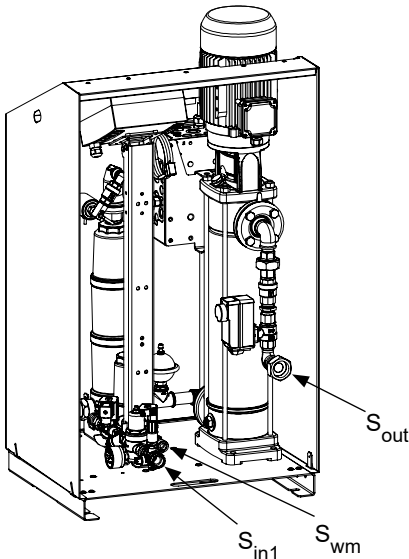



		VI 19.1	VI 25.1
dpu min	bar	6.5	10.5
dpu max	bar	15.5	20.5

		Sin1	Sout	Swm
Ts min	°C	0	0	0
Ts max	°C	90	90	65





$tr \leq 90^{\circ}\text{C}$

## Vento VI.1 E + Pleno P BA4R

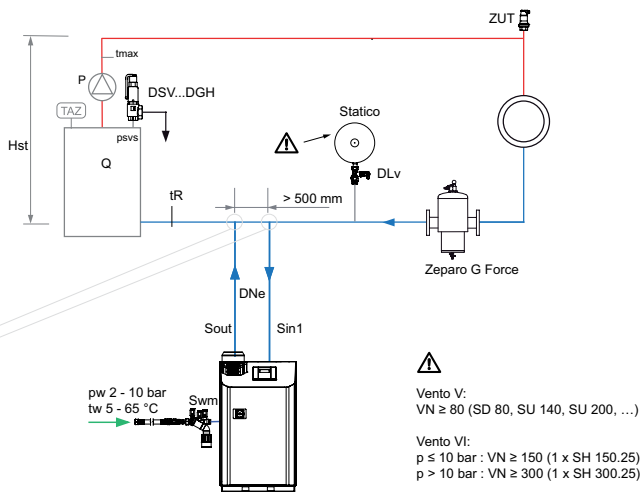

$tr > 0^{\circ}\text{C}$

## Vento VI.1 EC + Pleno P AB5 R + Pleno Refill

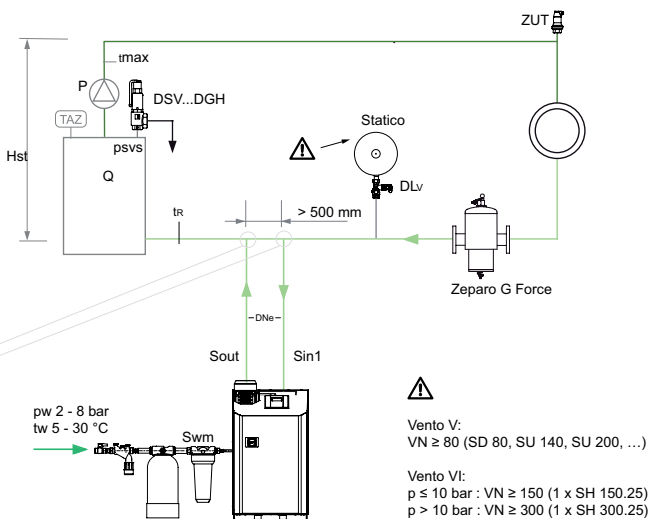

## DNe


		VI 19.1	VI 25.1
L max 10 m	DNe	25	25
L max 20 m	DNe	25	25
L max 30 m	DNe	32	32

#1-5



1

### 3x400 / 1x230V BrainCube PCI

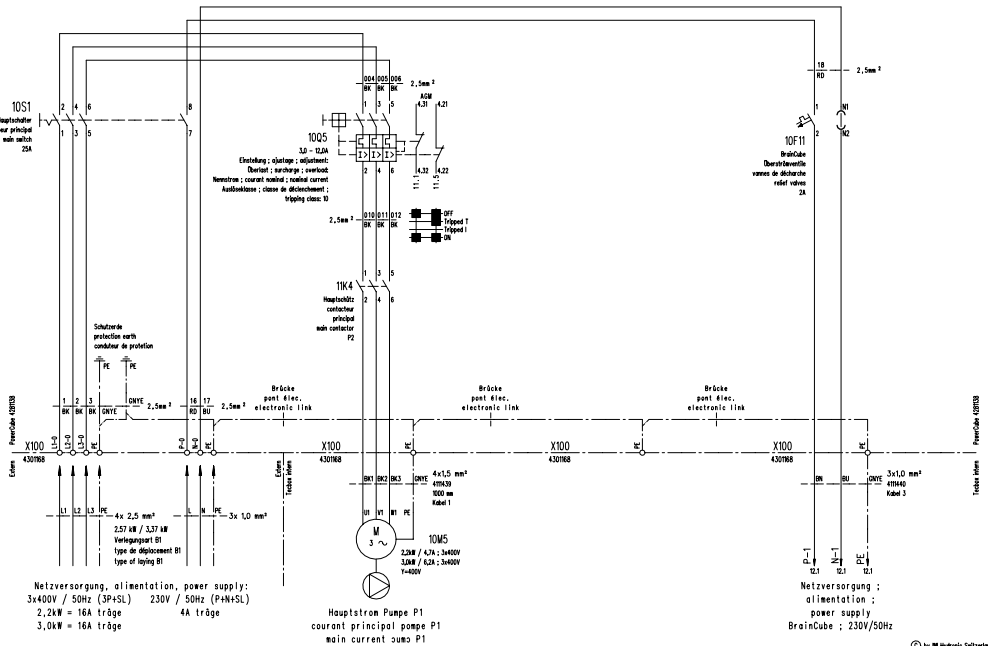

© by IM Hydrolec Switzerland AG




**WM:** Nachspeiseventil / Vanne d'appoint d'eau / Water make up valve



### 3 24 V BrainCube Connect





4



## BrainCube Connect



SELV ( $\leq 35$  VDC)

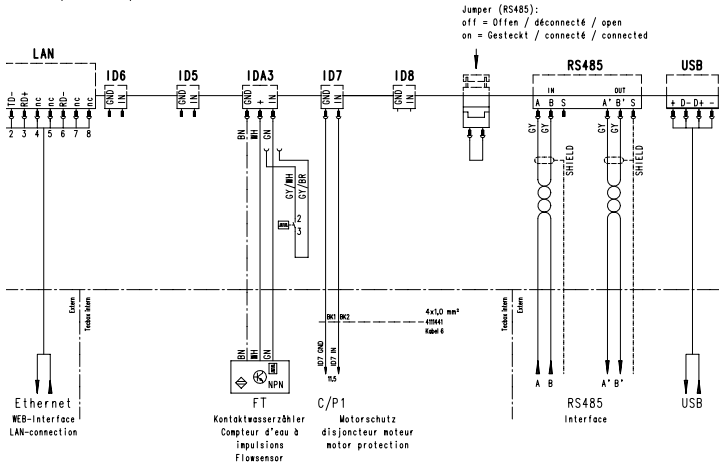


RS485

- Verbund (Gerätekommunikation) Fonctionnement combiné Master-Slave connection
- Nachspeisung Appoint d'eau Water make up
- Gebäudeleittechnik GLT Gestion technique du bâtiment GTB Building control system BCS


5



6

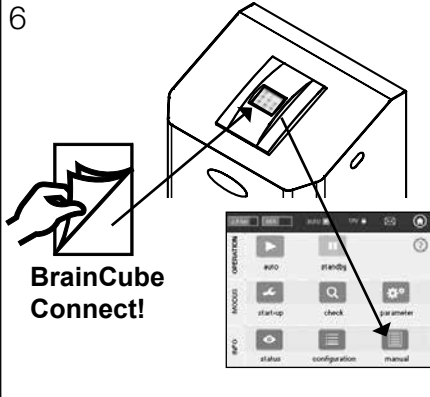

7



We reserve the right to introduce technical alterations without prior notice.

IMI Hydronic Engineering AG

(Teil von Climate Control, einem Sektor von IMI plc)

Mühlerrainstrasse 26 • CH-4414 Füllinsdorf

Tel. +41 (0)61 906 26 26



climatecontrol.imiplc.com