


TA-Slider 160 KNX Protocol Implementation v1.3

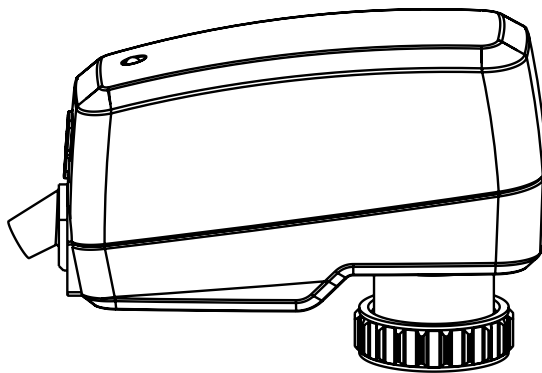

Identification in KNX ETS software

Product family: HVAC
 Product type: Valve
 Manufacturer: IMI Hydronic Engineering
 Name: TA-Slider 160 KNX
 Order number: 322224-0100X


Note: TA-Slider 160 KNX is ETS5 ready. The minimum ETS version is ETS5.0

Commissioning

The proportional electro-motor, TA-Slider 160 KNX, actuator is connected directly to the KNX bus; a separate bus coupler is not required.


The bus connection is carried out via the connecting cable which is fixed to the device with the help of a bus connecting terminal (not provided). An external auxiliary voltage is not necessary. It should be noted that a TA-Slider 160 KNX draws in stand-by less than 6 mA and as much as 25 mA when running in maximum load conditions.

The programming of the physical address can be carried out without contact by placing a magnet as shown in the picture.

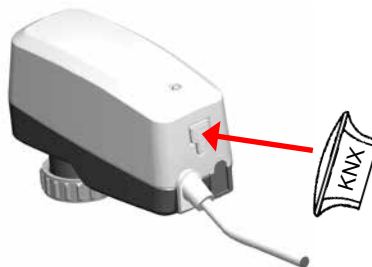

Wiring diagrams

TA-Slider 160 KNX

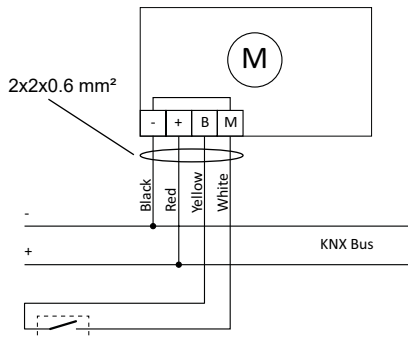

| Terminal | Description |
|----------|---|
| M | Neutral |
| B | Connection for potential free contact (e.g. open window detection), max. 100 Ω, max. 10 m cable or shielded |

Note: M terminal is internally connected to KNX “-” Bus wire.

KNX product catalogue

The KNX product catalogue file can be downloaded from our website under the “Documentation” section of TA-Slider 160. Refer to below table to find out which product catalogue version for which actuator firmware version.

| Firmware version | Required KNX product catalogue | Compatibility code on sticker | Production date |
|------------------|--------------------------------|-------------------------------|-------------------------------|
| 0.1.4 | TA-Slider_160_KNX_v1_1.knxprod | - | |
| 0.2.x | TA-Slider_160_KNX_v1_2.knxprod | - or 260 | From 2017-09-15 to 2019-11-14 |
| 0.3.x | TA-Slider_160_KNX_v1_3.knxprod | 262 | From 2019-11-15 to 2020-10-14 |
| 0.4.x | | | From 2020-10-15 |

The objects and parameters described in this document are those corresponding to firmware 0.3.x and 0.4.x (KNX product catalogue 1.3).

For previous versions, refer yourself to document “TA-Slider 160 KNX Protocol Implementation 1.2 and below”.

KNX protocol implementation

Available communication objects

| Obj | Object name | Object function | Type | Flags |
|-----|------------------------------------|---|---------|-------|
| 1a | Control value | Drive to position | 1 Bit | CW |
| 2a | Actual value | Indicate actual position | 2 Bytes | CRT |
| 1b | Control value | Drive to position | 1 Byte | CW |
| 2b | Actual value | Indicate actual position | 1 Byte | CRT |
| 1c | Control value | Drive to position | 2 Bytes | CW |
| 2c | Actual value | Indicate actual position | 2 Bytes | CRT |
| 3 | Detected stroke | Valve stroke detected by calibration | 2 Bytes | CRT |
| 4 | Force calibration | Relaunch a calibration (0:full; 1:fast) | 1 Bit | CW |
| 5 | Maximum valve stroke | Upper limit for detected stroke | 2 Bytes | CRW |
| 6 | Minimum stroke position | Lower threshold for position | 2 Bytes | CRW |
| 7* | Limited stroke | Max stroke limitation | 2 Bytes | CRW |
| 8* | 2nd limited stroke for change-over | 2nd max stroke limitation for change-over | 2 Bytes | CRW |
| 9* | Change-over | Change-over flag | 1 Bit | CW |
| 10* | Drive to forced position 1 | Go to pre-defined forced position 1 | 1 Bit | CW |
| 11* | Drive to forced position 2 | Go to pre-defined forced position 2 | 1 Bit | CW |
| 12* | Binary input | Binary input value | 1 Bit | CRT |
| 13 | Error code | Error code | 2 Bytes | CRT |

For communication objects 1 and 2 (Control value and Actual value), version a, b or c are mutually exclusive.

Communication objects marked with a * are available depending on configuration.

Error code is a bit field formatted as follows

| | | | | | | | | | | | | | | | |
|----|----|----|----|----|----|---|---|---|---|---|------|----|-----|----------|----|
| 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 | 0 |
| r | r | r | r | r | r | r | D | r | r | r | SOOR | CT | SDF | Clogging | PF |

r: Reserved

D: Degraded mode

SOOR: Signal out of range alarm

CT: Cyclic timeout alarm

SDF: Stroke detection failure

Clogging: Clogging alarm

PF: Power failure

Examples

“4” is “100” in binary representation. According to the table:

| | | | | | | | | | | | | | | | |
|----|----|----|----|----|----|---|---|---|---|---|------|----|-----|----------|----|
| 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 | 0 |
| r | r | r | r | r | r | r | D | r | r | r | SOOR | CT | SDF | Clogging | PF |
| 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 |

This “4” error means “SDF”

“6” is “110” in binary representation. According to the table:

| | | | | | | | | | | | | | | | |
|----|----|----|----|----|----|---|---|---|---|---|------|----|-----|----------|----|
| 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 | 0 |
| r | r | r | r | r | r | r | D | r | r | r | SOOR | CT | SDF | Clogging | PF |
| 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 |

This “6” error means “SDF” and “clogging”

Parameters – Main

Control type

Always available

Options:

| | | |
|-----------------------------------|---|--|
| a) Two points (1 bit telegram) | b) Proportional - Rough positioning (8 bit telegram) | c) Proportional - Fine positioning (10000 values) |
|-----------------------------------|---|--|

Default value: Proportional - Rough positioning (8 bit telegram)

Set the type of the control object.

Target position for control value 0

Available when Control type is a)

Parameter type: Integer

Range: Min: 0, Max: 10000

Default value: 0

Unit: per 10000

Setpoint when a 0 is sent (control value is binary).

Target position for control value 1

Available when Control type is a)

Parameter type: Integer

Range: Min: 0, Max: 10000

Default value: 10000

Unit: per 10000

Setpoint when a 1 is sent (control value is binary).

Characteristic

Available when Control type is b) or c)

Options:

| | | |
|--------|---------------------------------|--------------|
| Linear | Equal Percentage Modified (EQM) | Inverted EQM |
|--------|---------------------------------|--------------|

Default value: Linear

Characteristic curve of the valve.

Hysteresis

Available when Control type is b) or c)

Options:

| | | | | | | | |
|----------|----|----|----|----|----|-----|-----|
| Accurate | 1% | 2% | 3% | 5% | 7% | 10% | 15% |
|----------|----|----|----|----|----|-----|-----|

Default value: 2 %

Move the actuator only when the signal goes beyond this margin.

Control direction

Always available

Options:

| | |
|--|--|
| Direct (0% = fully extended actuator; for push-to-close valves) | Reversed (0% = fully retracted actuator; for push-to-open valves) |
|--|--|

Default value: Direct (0% = fully extended actuator; for push-to-close valves)

Valve direction of the input signal.

Initial control value

Always available

Parameter type: Integer

Range: Min: 0, Max: 10000

Default value: 10000

Unit: per 10000

Control value at power on before receiving first control value object.

Cyclic timeout*Always available*

Options:

| | | | | | | | | | |
|----|-------|-------|-------|--------|--------|--------|--------|--------|--------|
| No | 1 min | 2 min | 5 min | 10 min | 15 min | 20 min | 30 min | 45 min | 60 min |
|----|-------|-------|-------|--------|--------|--------|--------|--------|--------|

Default value: No

Raise an error if the actuator didn't receive a control signal for the time being. This indicates the frequency of the input signal.

Periodic transmission of actual position*Always available*

Options:

| | | | | | | | | | |
|----|-------------|-------------|-------------|--------------|--------------|--------------|--------------|--------------|--------------|
| No | Every 1 min | Every 2 min | Every 5 min | Every 10 min | Every 15 min | Every 20 min | Every 30 min | Every 45 min | Every 60 min |
|----|-------------|-------------|-------------|--------------|--------------|--------------|--------------|--------------|--------------|

Default value: No

Define the frequency of the actual position transmission.

On-change transmission of actual position*Always available*

Options:

| | | | | | | | |
|----|-----|-----|-----|-----|-----|------|------|
| No | 1 % | 2 % | 3 % | 5 % | 7 % | 10 % | 15 % |
|----|-----|-----|-----|-----|-----|------|------|

Default value: No

Define the delta of the actual position that trigger a transmission.

Maximum valve stroke*Always available*

Parameter type: Integer

Range: Min: 250, Max: 8500

Default value: 6900

Unit: μm

Limit the detection range for the calibration to this upper value.

Activate LED?*Always available*

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: Yes

Deactivate LED for a discreet device.

One side approach? (motor usage will increase)*Always available*

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No

Reduce gear's play by reaching the position from the same side (improved positioning).

Minimum stroke position*Always available*

Parameter type: Integer

Range: Min: 0, Max: 8500

Default value: 0

Unit: μm

Indicate a minimum stroke position.

Continues on next page

Enable maximum stroke limitation?

Always available

Options:

| | |
|----------|---------|
| Disabled | Enabled |
|----------|---------|

Default value: Disabled

Enable the stroke limitation.

Limited stroke

Available when stroke limitation is enabled

Parameter type: Integer

Range: Min: 250, Max: 8500

Default value: 6900

Unit: μm

Indicate the Limited stroke value.

Enable change-over?

Available when stroke limitation is enabled

Options:

| | |
|----------|---------|
| Disabled | Enabled |
|----------|---------|

Default value: Disabled

According to the selected trigger (telegram or binary input), set the cooling or the heating mode.

Change-over trigger

Available when Change-over is enabled

Options:

| | |
|--------------|--|
| KNX telegram | Binary input (Overrides binary input settings) |
|--------------|--|

Default value: KNX telegram

Select the source for the change-over.

Limited stroke when change-over is triggered

Available when Change-over is enabled

Parameter type: Integer

Range: Min: 250, Max: 8500

Default value: 6900

Unit: μm

Override the limited stroke when the change-over is active.

Mode when change-over is triggered

Available when Change-over is enabled

Options:

| | |
|---------|---------|
| Cooling | Heating |
|---------|---------|

Default value: Cooling

Selected mode when the change-over is active.

Parameters – Maintenance

Calibration at power on

Always available

Options:

| | | |
|------|------|------|
| None | Full | Fast |
|------|------|------|

Default value: Full
Type of calibration done at power on.

Automatic calibration refresh

Always available

Options:

| | | |
|-------|--------|---------|
| Never | Weekly | Monthly |
|-------|--------|---------|

Default value: Never
Perform a calibration at this frequency.

Enable forced position 1?

Always available

Options:

| | |
|----------|---------|
| Disabled | Enabled |
|----------|---------|

Default value: Disabled
Enable the configuration of a forced position 1.

Forced position 1

Available when forced position_1 is enabled

Parameter type: Integer
Range: Min: 0, Max: 10000
Default value: 0
Unit: per 10000
Value of the forced position 1.

Forced position 1 applies to

Available when forced position_1 is enabled

Options:

| | |
|----------------|-------------|
| Limited stroke | Full stroke |
|----------------|-------------|

Default value: Limited stroke
Define the range of forced position 1.

Enable forced position 2?

Available when forced position_2 is enabled

Always available

Options:

| | |
|----------|---------|
| Disabled | Enabled |
|----------|---------|

Default value: Disabled
Enable the configuration of forced position 2.

Forced position 2

Available when forced position_2 is enabled

Parameter type: Integer
Range: Min: 0, Max: 10000
Default value: 10000
Unit: per 10000
Value of the forced position 2.

Continues on next page

Forced position 2 applies to

Available when forced position_2 is enabled

Options:

| | |
|----------------|-------------|
| Limited stroke | Full stroke |
|----------------|-------------|

Default value: Limited stroke

Define the range of forced position 2.

Highest priority

Available when forced position_1 and forced position_2 are enabled

Options:

| | |
|-------------------|-------------------|
| Forced position 1 | Forced position 2 |
|-------------------|-------------------|

Default value: Forced position 1

Define the highest priority if both forced position are activated.

Valve blockage protection

Available when forced position_1 and forced position_2 are enabled

Options:

| | | |
|-------|--------|---------|
| Never | Weekly | Monthly |
|-------|--------|---------|

Default value: Never 1

Automatically moves by a quarter of its stroke if the actuator has not moved during the specified period.

Parameters – Binary input

Activate binary input?

Always available

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No

Enable the binary input.

Binary input trigger

Available when binary input is enabled

Options:

| | |
|------|--------|
| Open | Closed |
|------|--------|

Default value: Open

Set the triggered state of the binary input.

Binary input action

Available when binary input is enabled

Options:

| | |
|------|----------------|
| None | Go to position |
|------|----------------|

Default value: None

Select the action to take when the binary input is triggered (can additionally activate the change-over through the corresponding option).

Binary input position

Available when binary input action is set to Go to position

Parameter type: Integer
Range: Min: 0, Max: 10000
Default value: 0
Unit: per 10000

Set the position to reach when the binary input is triggered (and the 'Go to position' option is selected).

Periodic transmission of input state

Available when binary input is enabled

Options:

| | | | | | | | | | |
|------|----------------|----------------|----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| None | Every 1 min | Every 2 min | Every 5 min | Every 10 min | Every 15 min | Every 20 min | Every 30 min | Every 45 min | Every 60 min |
|------|----------------|----------------|----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|

Default value: None
Transmit the binary input state at the selected frequency.

On-change transmission of input state

Available when binary input is enabled

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No
Transmit the new binary input state on status change.

Parameters – Error

Send status in case of error?

Always available

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No
Transmit the error status on the KNX bus when one appears.

On valve clogging, perform unblocking attempts

Always available

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No
If the valve is clogged, performs three attempts to unblock it.

On valve clogging, move to fully open valve position

Always available

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: Yes
If the valve is clogged, set the valve fully open.

Forced error position*Always available*

Parameter type: Integer
Range: Min: 0, Max: 10000
Default value: 0
Unit: per 10000

Depending on the selected options, move to this position when an error is detected.

Move to error position on stroke detection failure*Always available*

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No

Move to the defined position when a stroke detection failure happens.

Move to error position on cyclic instruction timeout*Always available*

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No

Move to the defined position when a cyclic instruction timeout happens.

Move to error position on control value out of range*Always available*

Options:

| | |
|-----|----|
| Yes | No |
|-----|----|

Default value: No

Move to the defined position when the control value is out of range (for control values 0-10000).

We reserve the right to introduce technical alterations without prior notice.